

Annexure No. _____


INDIVIDUAL HARDNESS VARIATION RECORD

Test No. _____

Product Name	MELOXICAM 15 mg TABLETS USPM		
Batch No.	4KA3048	Department	Production
BFG Code No.	31003854	Date	23.04.2026
No. of Samples	5	Start Time	17:40
Equipment Code No.	777	Vernier Code No.	
Std Hardness (N)	63.0	Side	LHS
Std. Lower Limit (N)	0.0	Std. Upper Limit (N)	0.0

Test Results

Average Hardness (N)	63.360	Standard Deviation	1.198
Minimum Hardness (N)	61.500	No. of Tablets Below Limit	0
Maximum Hardness (N)	65.000	No. of Tablets Above Limit	0

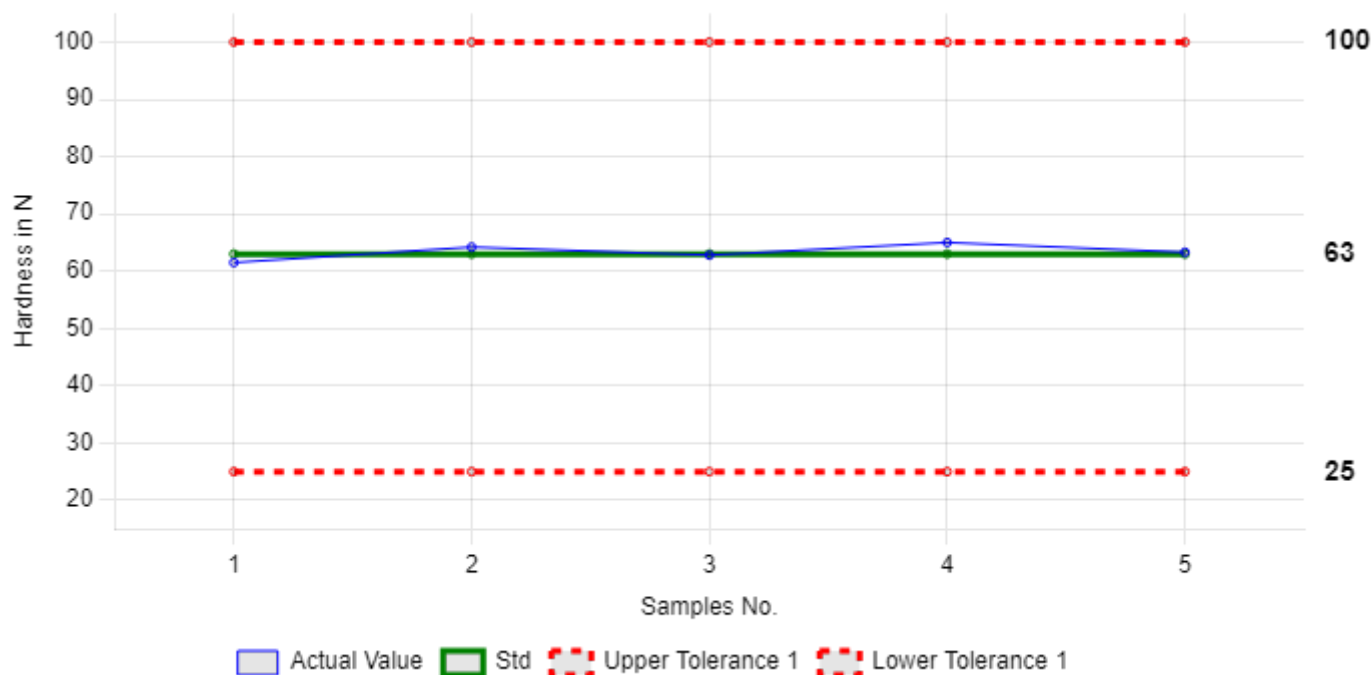

Sample No.	Hardness (N)	Sample No.	Hardness (N)	Sample No.	Hardness (N)	Sample No.	Hardness (N)	Sample No.	Hardness (N)
1	61.5	2	64.2	3	62.8	4	65	5	63.3

Result: **Complies**

Done by: Tushar

Date/Time: 23.04.2026 17:40