


REGULAR DIFFERENTIAL WEIGHT VARIATION REPORT

Product Name	captab capsules		
Batch No.	BT-CAPSULE1009	Department	QC
BFG Code No.	bfg-002	Date	02.09.2025
No. of Samples	3	Start Time	11:57:20
Equipment Code No.	Equipment-123	Balance Code No.	BAL-001
Standard Weight of Capsules (g)	0.400	Side	NA
Std. Limit 1 (Net) (g)	NMT 2 capsules by \pm 2.00 %		0.392 - 0.408
Std. Limit 2 (Net) (g)	None of capsules by \pm 3.00 %		0.388 - 0.412

Test Results

Avg. Weight of Filled Content (g)	0.4130	Standard Deviation	0.0062
Minimum Weight (g)	0.408	No. of Capsules Above Limit (1)	0.408 1
Maximum Weight (g)	0.420	No. of Capsules Below Limit (1)	0.392 0
Minimum %	2.00	No. of Capsules Above Limit (2)	0.412 1
Maximum %	5.00	No. of Capsules Below Limit (2)	0.388 0
Avg. Weight of Filled Capsule (g)	0.5070		

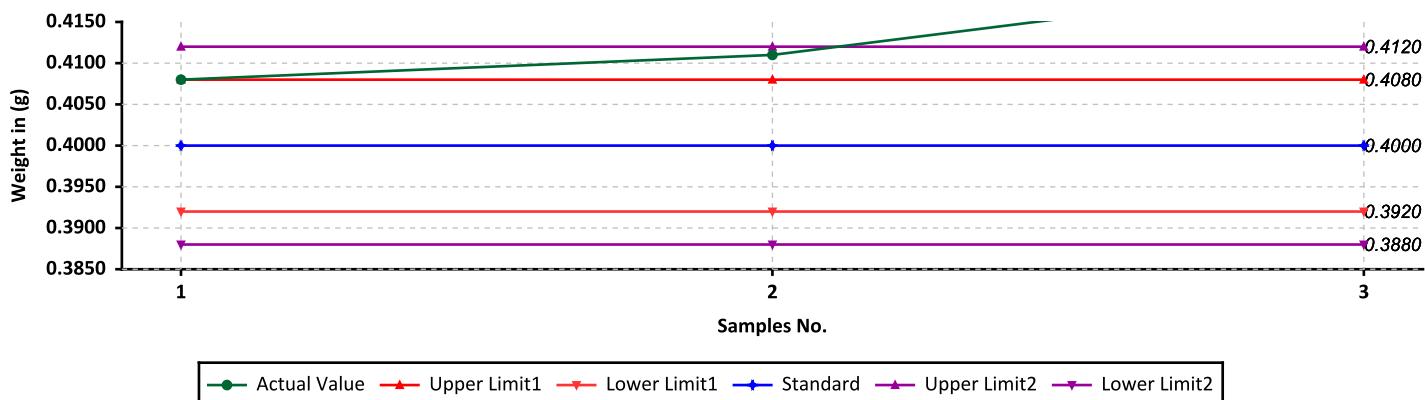

Sample No.	Filled Capsule Weight (g)	Empty Capsule Weight (g)	Filled Content (g)	Sample No.	Filled Capsule Weight (g)	Empty Capsule Weight (g)	Filled Content (g)
1	0.500	0.092	0.408	2	0.501	0.090	0.411
3	0.520	0.100	0.420				

Result: Not Complies

Performed by : kuldeep

Checked by : Mangesh

Date : 02.09.2025 & 11:57:20

Date : 02.09.2025 & 11:58:50