


INITIAL DIFFERENTIAL WEIGHT VARIATION REPORT

Product Name	captab capsules		
Batch No.	BT-IPQCCAP-1020	Department	QC
BFG Code No.	bfg-002	Date	03.09.2025
No. of Samples	3	Start Time	15:57:46
Equipment Code No.	None	Balance Code No.	BAL1707
Standard Weight of Capsules (g)	0.400	Side	NA
Std. Limit 1 (Net) (g)	NMT 2 capsules by \pm 2.00 %		0.392 - 0.408
Std. Limit 2 (Net) (g)	None of capsules by \pm 3.00 %		0.388 - 0.412

Test Results

Avg. Weight of Filled Content (g)	0.4033	Standard Deviation	0.0015
Minimum Weight (g)	0.402	No. of Capsules Above Limit (1)	0.408
Maximum Weight (g)	0.405	No. of Capsules Below Limit (1)	0.392
Minimum %	0.50	No. of Capsules Above Limit (2)	0.412
Maximum %	1.25	No. of Capsules Below Limit (2)	0.388
Avg. Weight of Filled Capsule (g)	0.5013		

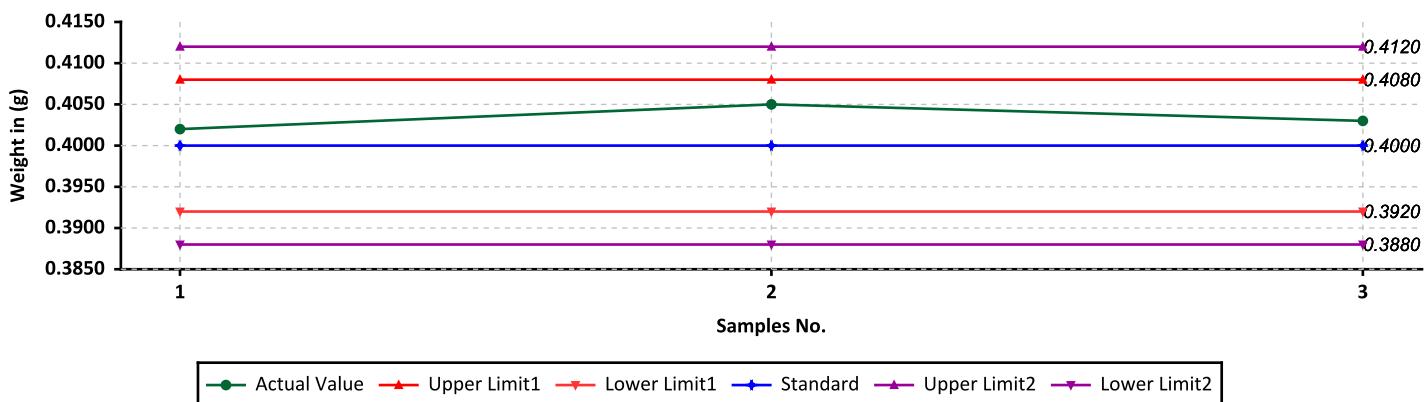

Sample No.	Filled Capsule Weight (g)	Empty Capsule Weight (g)	Filled Content (g)	Sample No.	Filled Capsule Weight (g)	Empty Capsule Weight (g)	Filled Content (g)
1	0.505	0.103	0.402	2	0.500	0.095	0.405
3	0.499	0.096	0.403				

Result: **Complies**

Performed by : kuldeep

Checked by : Mangesh

Date : 03.09.2025 & 15:57:46

Date : 03.09.2025 & 16:00:10