


REGULAR DIFFERENTIAL WEIGHT VARIATION REPORT

Product Name	captab capsules		
Batch No.	BT-1207	Department	NA
BFG Code No.	bfg-002	Date	29.10.2025
No. of Samples	5	Start Time	16:55:24
Equipment Code No.	Equipment-123	Balance Code No.	BAL-001
Net Weight of Capsules (g)	0.400	Side	NA
Std. Limit 1 (Net) (g)	NMT 2 capsules by $\pm 2.00\%$		0.392 - 0.408
Std. Limit 2 (Net) (g)	None of capsules by $\pm 3.00\%$		0.388 - 0.412

Test Results

Avg. Weight of Filled Content (g)	0.3954	Standard Deviation	0.0035
Minimum Weight (g)	0.391	No. of Capsules Above Limit (1) 0.408	0
Maximum Weight (g)	0.400	No. of Capsules Below Limit (1) 0.392	1
Minimum %	2.25	No. of Capsules Above Limit (2) 0.412	0
Maximum %	0.00	No. of Capsules Below Limit (2) 0.388	0
Avg. Weight of Filled Capsule (g)	0.5060	Weight of 5 Empty Capsules (g)	0.553

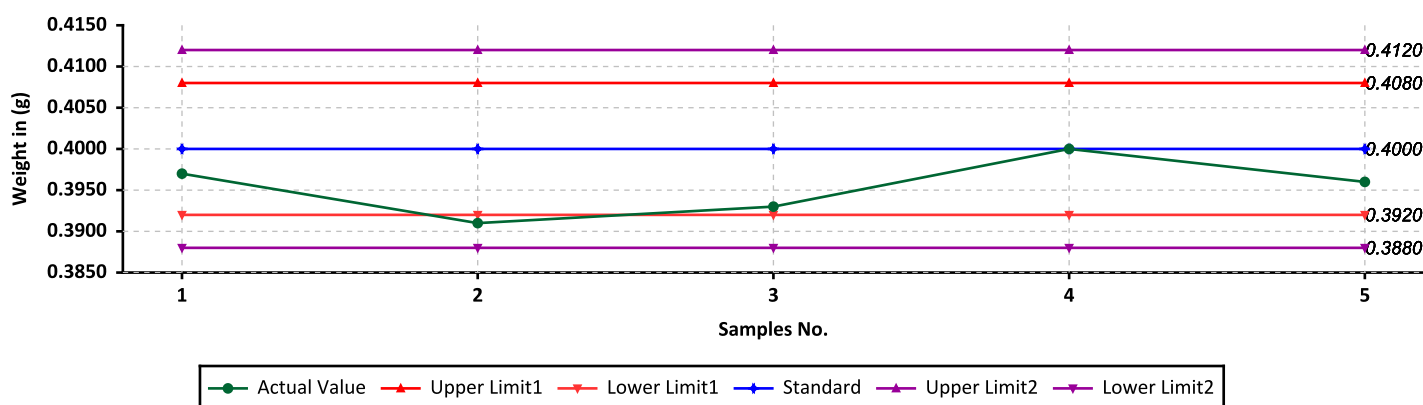

Sample No.	Filled Capsule Weight (g)	Empty Capsule Weight (g)	Filled Content (g)	Sample No.	Filled Capsule Weight (g)	Empty Capsule Weight (g)	Filled Content (g)
1	0.500	0.103	0.397	2	0.500	0.109	0.391
3	0.500	0.107	0.393	4	0.510	0.110	0.400
5	0.520	0.124	0.396				

Result: Not Complies
Remark: Test

Performed by : Mangesh

Checked by : kuldeep

Date & Time : 29.10.2025 & 16:55:48

Date & Time : 29.10.2025 & 16:56:11