


REGULAR DIFFERENTIAL WEIGHT VARIATION REPORT

Product Name	cap45		
Batch No.	new222	Department	QC
BFG Code No.	capsule-01	Date	03.01.2026
No. of Samples	1	Start Time	11:12:24
Equipment Code No.	ENC_1	Balance Code No.	BCN_10
Net Weight of Capsules (g)	0.300	Side	NA
Std. Limit 1 (Net) (g)	NA		NA
Std. Limit 2 (Net) (g)	None of capsules deviate by ± 3.00 %		0.291 - 0.309
Stage	Capsulation		

Test Results

Avg. Weight of Filled Content (g)	1.0000	Standard Deviation	0.0000
Minimum Weight (g)	1.000	No. of Capsules Above Limit (1)	NA
Maximum Weight (g)	1.000	No. of Capsules Below Limit (1)	NA
Minimum %	233.33	No. of Capsules Above Limit (2) 0.309	1
Maximum %	233.33	No. of Capsules Below Limit (2) 0.291	0
Avg. Weight of Filled Capsule (g)	2.5000	Weight of 1 Empty Capsules (g)	1.500

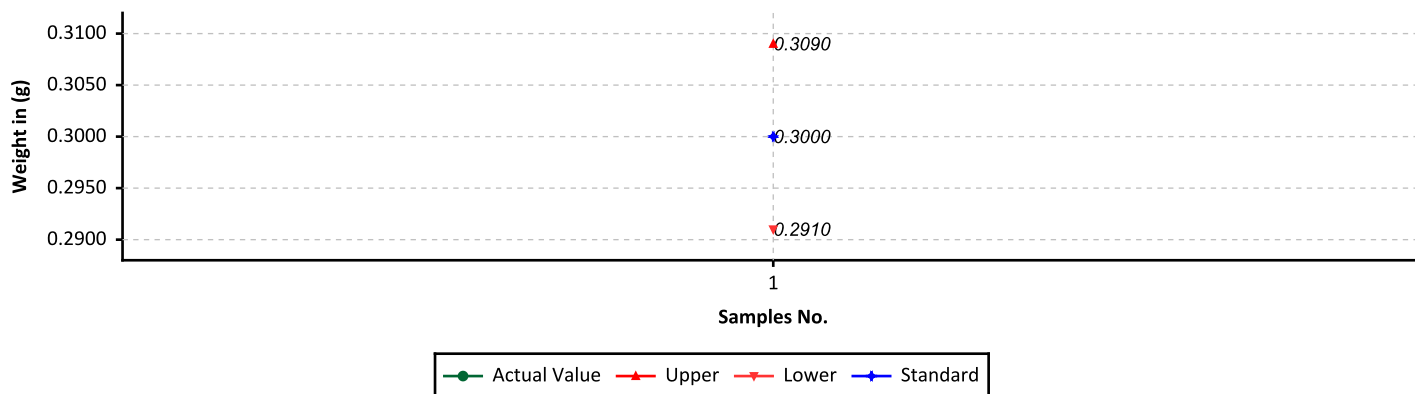

Sample No.	Filled Capsule Weight (g)	Empty Capsule Weight (g)	Filled Content (g)
1	2.500	1.500	1.000

Result: **Not Complies**

Performed by : yogita

Date & Time : 03.01.2026 & 11:12:28