


## REGULAR DIFFERENTIAL WEIGHT VARIATION REPORT

<b>Product Name</b>	captab capsules		
<b>Batch No.</b>	IPQCCAPS-1047	<b>Department</b>	QC
<b>BFG Code No.</b>	bfg-002	<b>Date</b>	05.09.2025
<b>No. of Samples</b>	3	<b>Start Time</b>	11:19:44
<b>Equipment Code No.</b>	ECN_10	<b>Balance Code No.</b>	BAL-006
<b>Standard Weight of Capsules (g)</b>	0.400	<b>Side</b>	NA
<b>Std. Limit 1 (Net) (g)</b>	NMT 2 capsules by $\pm$ 2.00 %		0.392 - 0.408
<b>Std. Limit 2 (Net) (g)</b>	None of capsules by $\pm$ 3.00 %		0.388 - 0.412

## Test Results

Avg. Weight of Filled Content (g)	0.4000	Standard Deviation	0.0010
Minimum Weight (g)	0.399	No. of Capsules Above Limit (1)	0.408
Maximum Weight (g)	0.401	No. of Capsules Below Limit (1)	0.392
Minimum %	0.25	No. of Capsules Above Limit (2)	0.412
Maximum %	0.25	No. of Capsules Below Limit (2)	0.388
Avg. Weight of Filled Capsule (g)	0.5000		

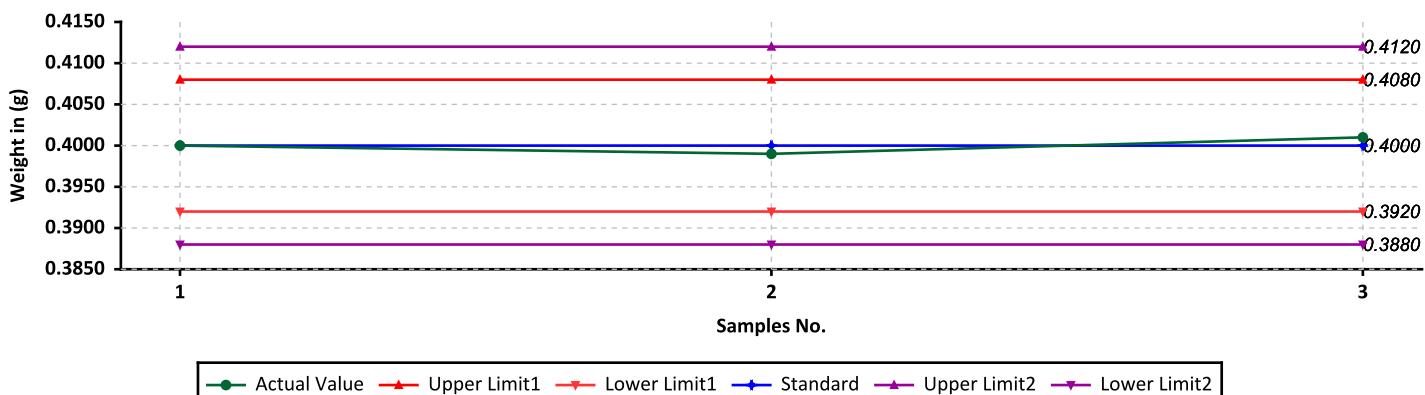

Sample No.	Filled Capsule Weight (g)	Empty Capsule Weight (g)	Filled Content (g)	Sample No.	Filled Capsule Weight (g)	Empty Capsule Weight (g)	Filled Content (g)
1	0.500	0.100	0.400	2	0.500	0.101	0.399
3	0.500	0.099	0.401				

**Result:** Complies

**Performed by** : kuldeep

**Checked by** : Mangesh

**Date** : 05.09.2025 & 11:19:44

Date : 05.09.2025 & 11:23:36