


REGULAR GROUP WEIGHT VARIATION REPORT

Product Name	Hydrachloride 500mg IP Capsule		
Batch No.	BT-12300	Department	QC
BFG Code No.	1411	No. of Samples	5
Equipment Code No.	None	Balance Code No.	Balance-121212
Std. Group Wt. of Cap. (gm)	10.000	Stage	NA
Std. Lower Limit (gm)	9.700(-3.00 %)	Std. Upper Limit (gm)	10.300(+3.00 %)
Side	NA		

Test Results

Min Group Wt. of Cap. (gm)	1.300	No. Of Group Wt. Below Limit	1
Max Group Wt. of Cap. (gm)	10.300	No. Of Group Wt. Above Limit	0
Start Weight (gm)	1.300	End Weight (gm)	10.300
Average Weight	5.8000		

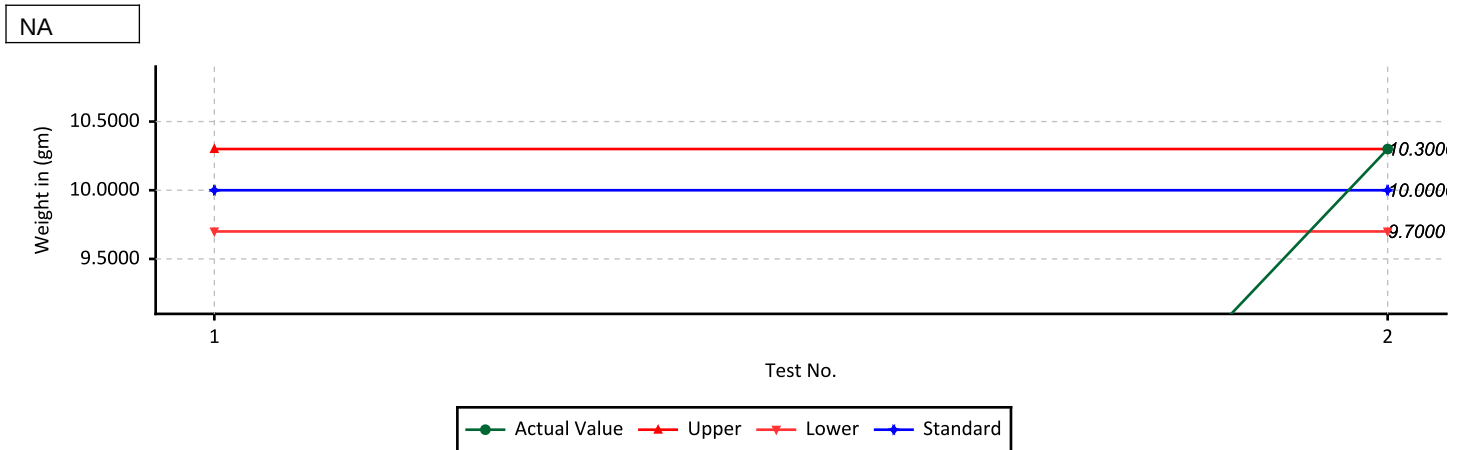

Test No.	Date	Time	Side	Group Weight (gm)	Test Result	Performed By
1.	13.10.2024	11:24:19	Single	1.300	Not Complies	Priti
2.	13.10.2024	11:25:04	Single	10.300	Complies	Priti

Result: **Not Complies**