


REGULAR INDIVIDUAL WEIGHT VARIATION REPORT

Product Name	captab capsules		
Batch No.	BT-1207	Department	NA
BFG Code No.	bfg-002	Date	29.10.2025
No. of Samples	5	Start Time	16:50:27
Equipment Code No.	Equipment-123	Balance Code No.	BAL-001
Standard Weight of Capsules (g)	0.500	Side	NA
Std. Limit 1 (g)	NMT 2 capsules by \pm 2.00 %		0.490 - 0.510
Std. Limit 2 (g)	None of capsules by \pm 4.00 %		0.480 - 0.520

Test Results

Average Weight of Capsules (g)	0.4982	Standard Deviation	0.0146
Minimum Weight (g)	0.483	No. of Capsules Above Limit (1) 0.510	1
Maximum Weight (g)	0.516	No. of Capsules Below Limit (1) 0.490	2
Minimum %	3.40	No. of Capsules Above Limit (2) 0.520	0
Maximum %	3.20	No. of Capsules Below Limit (2) 0.480	0

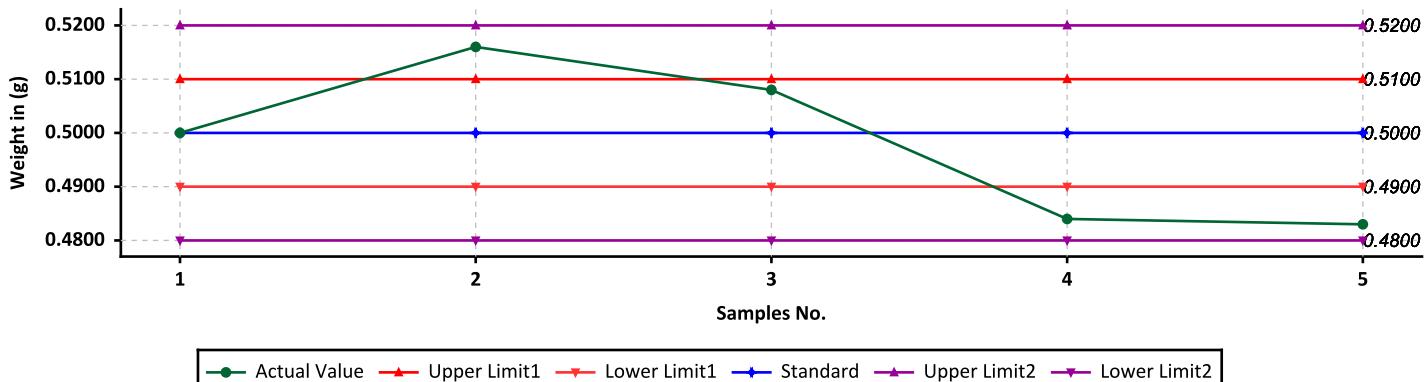

Sample No.	Weight in (g)								
1	0.500	2	0.516	3	0.508	4	0.484	5	0.483

Result: **Not Complies**

Remark: Test

Performed by : Mangesh

Checked by : kuldeep

Date & Time : 29.10.2025 & 16:50:46

Date & Time : 29.10.2025 & 16:51:13