


REGULAR INDIVIDUAL WEIGHT VARIATION REPORT

Product Name	cap45		
Batch No.	reg-capsule	Department	QC
BFG Code No.	capsule-01	Date	01.01.2026
No. of Samples	5	Start Time	11:29:31
Equipment Code No.	ENC_1	Balance Code No.	BAL-231225
Standard Weight of Capsules (g)	0.500	Side	NA
Std. Limit T1 (g)	NA		NA
Std. Limit T2 (g)	None of capsules deviate by $\pm 3.00\%$		0.485 - 0.515
Stage	Capsulation		

Test Results

Average Weight of Capsules (g)	0.4958	Standard Deviation	0.0108
Minimum Weight (g)	0.485	No. of Capsules Above Limit (T1)	NA
Maximum Weight (g)	0.510	No. of Capsules Below Limit (T1)	NA
Minimum %	3.00	No. of Capsules Above Limit (T2) 0.515 (g)	0
Maximum %	2.00	No. of Capsules Below Limit (T2) 0.485 (g)	0

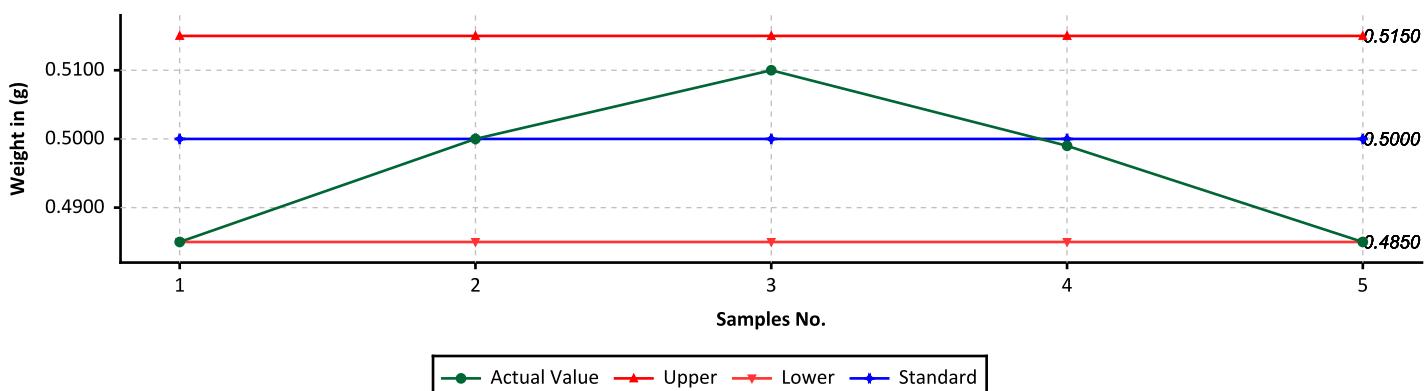

Sample No.	Weight in (g)								
1	0.485	2	0.500	3	0.510	4	0.499	5	0.485

Result: Complies
Performed by : Tantra

Date & Time : 01.01.2026 & 11:29:58