


INCOMPLETE REGULAR THICKNESS VARIATION REPORT

Product Name	PARACETAMOL_15 MG		
Batch No.	8592	Department	QA
BFG Code No.	PARA_123	Date	11.12.2024
No. of Samples	4	Start Time	14:54:36
Equipment Code No.	EQ 22222222222222222222 @	Vernier Code No.	Ver_24
Standard Thickness (mm)	7.00	Side	NA
Std. Lower Limit (mm)	6.70	Std. Upper Limit (mm)	7.30

Test Results

Average Thickness	12.84	Standard Deviation	0.0000
Minimum Thickness (mm)	12.84	No. of Tablets Below Limit	0
Maximum Thickness (mm)	12.84	No. of Tablets Above Limit	2

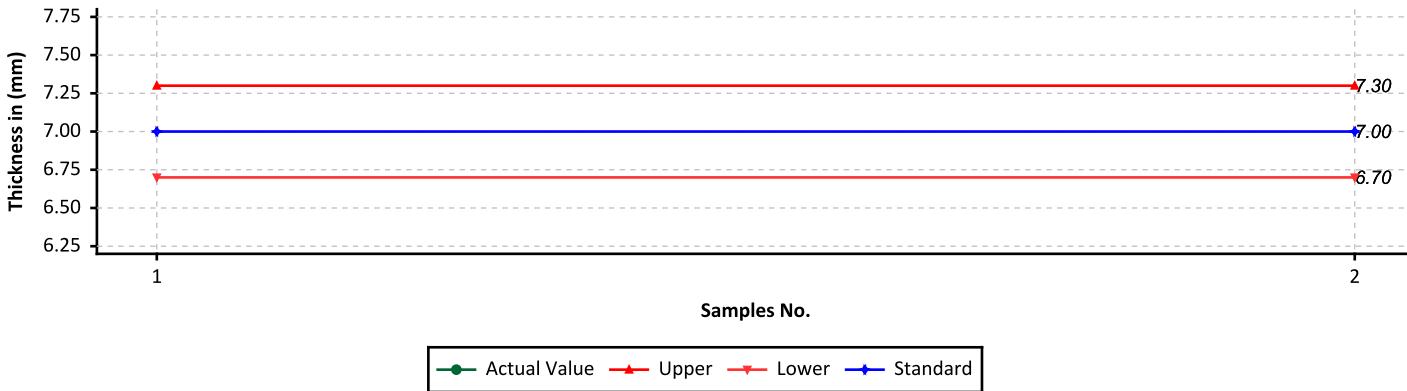

Sample No.	Thickness (mm)	Sample No.	Thickness (mm)
1	12.84	2	12.84

Result: Aborted test

Performed by : Priti

Date : 11.12.2024