


INITIAL BREADTH VARIATION REPORT

Product Name	PARACETAMOL_50 MG		
Batch No.	BT-ACC	Department	QC
BFG Code No.	PARA_TAB001	Date	04.09.2025
No. of Samples	3	Start Time	12:58:12
Equipment Code No.	EQ Code No-1	Vernier Code No.	VER003
Standard Breadth (mm)	4.50	Side	RHS
Std. Lower Limit (mm)	4.30	Std. Upper Limit (mm)	4.80

Test Results

Average Breadth (mm)	4.68	Standard Deviation	0.1253
Minimum Breadth (mm)	4.55	No. of Tablets Below Limit	0
Maximum Breadth (mm)	4.80	No. of Tablets Above Limit	0

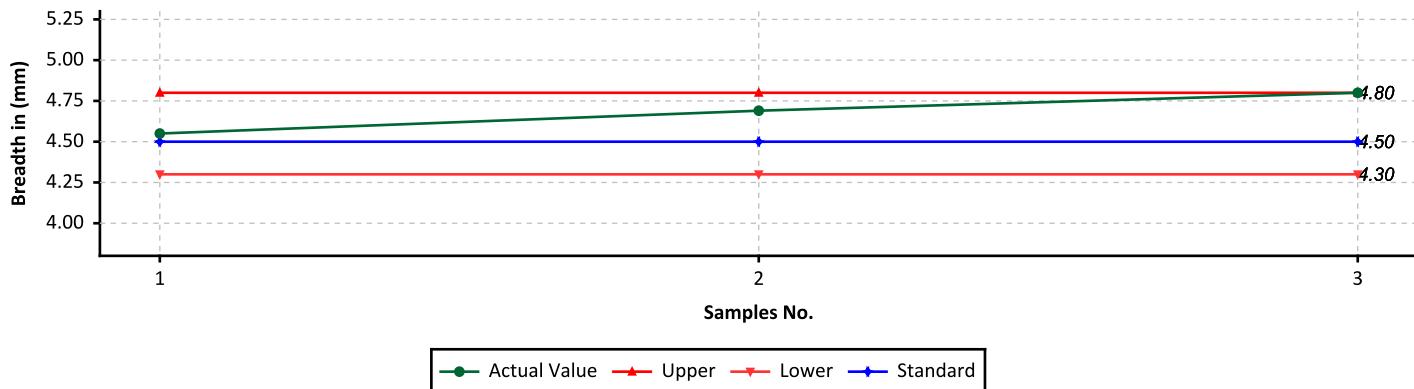

Sample No.	Breadth (mm)	Sample No.	Breadth (mm)	Sample No.	Breadth (mm)
1	4.55	2	4.69	3	4.80

Result: Complies
Remark: qwerthjwerth
Performed by : kumkum

Date : 04.09.2025 & 12:58:12

Checked by : Tantra

Date : 04.09.2025 & 12:59:30