


REGULAR DIAMETER VARIATION REPORT

Product Name	DI -Tab 500Mg		
Batch No.	BT-02	Department	QC
BFG Code No.	1213121	Date	13.10.2025
No. of Samples	5	Start Time	11:52:56
Equipment Code No.	EQ 1	Vernier Code No.	VN 1
Standard Diameter (mm)	9.00	Lot No.	342
Std. Lower Limit (mm)	8.70	Std. Upper Limit (mm)	9.30
Stage	Coating		

Test Results

Average Diameter (mm)	8.97	Standard Deviation	0.1955
Minimum Diameter (mm)	8.75	No. of Tablets Below Limit	0
Maximum Diameter (mm)	9.25	No. of Tablets Above Limit	0

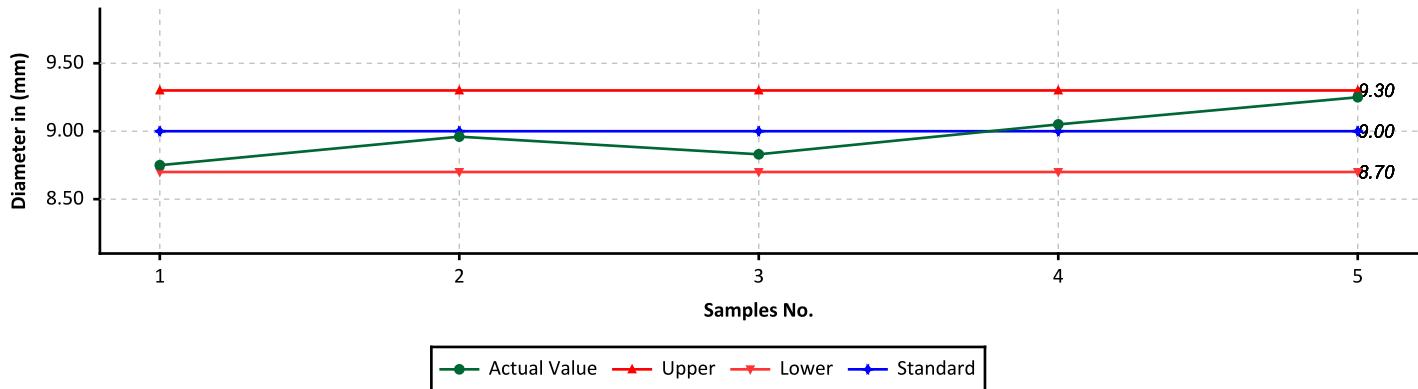

Sample No.	Diameter (mm)								
1	8.75	2	8.96	3	8.83	4	9.05	5	9.25

Result: Complies

Remark: tets

Performed by : Mangesh

Date & Time : 13.10.2025 & 11:53:05

Checked by : kuldeep

Date & Time : 13.10.2025 & 11:53:31